


Skydome® Edge Pendant

FSDEP-22|33|44



FOCAL POINT®

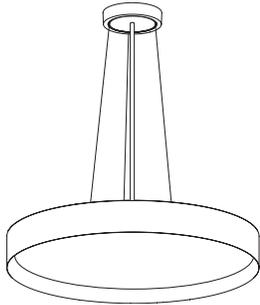


WEIGHTS:

- 2' - 23.6 LBS
2 PEOPLE RECOMMENDED FOR INSTALLATION
- 3' - 48.3 LBS
3 PEOPLE RECOMMENDED FOR INSTALLATION
- 4' - 82.4 LBS
3 PEOPLE RECOMMENDED FOR INSTALLATION

KEY





- POWER OFF
- POWER ON
- ATTENTION

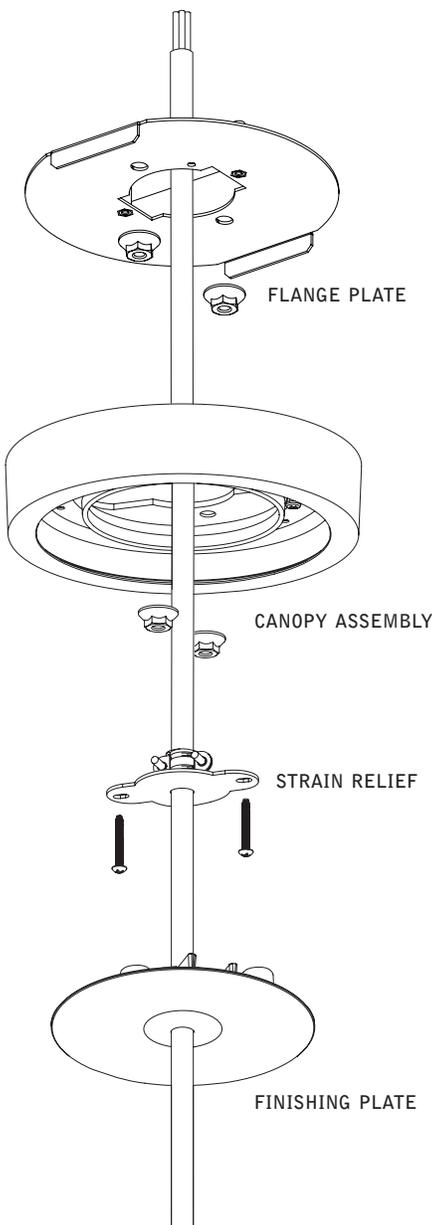






PLEASE CONSULT NEC & ELECTRICAL CODE FOR JUNCTION BOX VOLUME REQUIREMENTS. JUNCTION BOX EXTENSIONS MAY BE NECESSARY.

FOR JUNCTION BOX VOLUME AND SIZING, LUMINAIRE HAS AN 18AWG, 9-WIRE CORD AND AN 18AWG GROUND CONDUCTOR.







CANOPY IS COMPATIBLE WITH 4" OCTAGON, 4" SQUARE, AND CORRESPONDING EXTENSIONS, WITHOUT MUD RINGS.

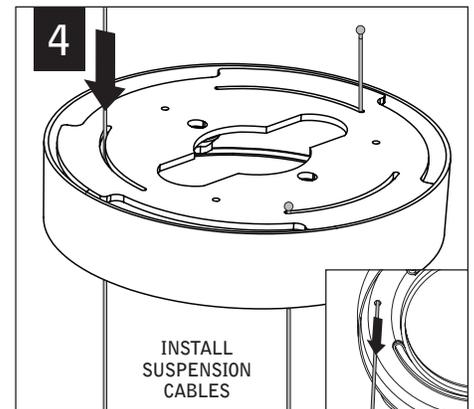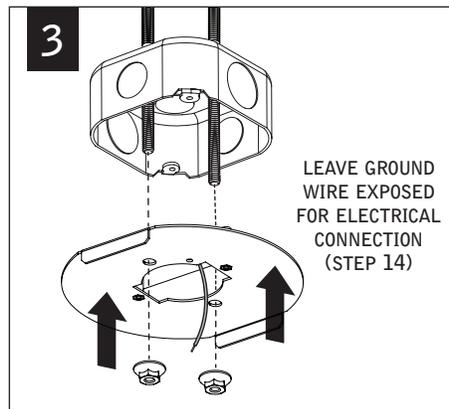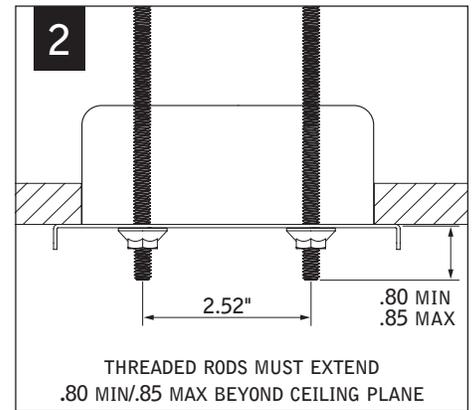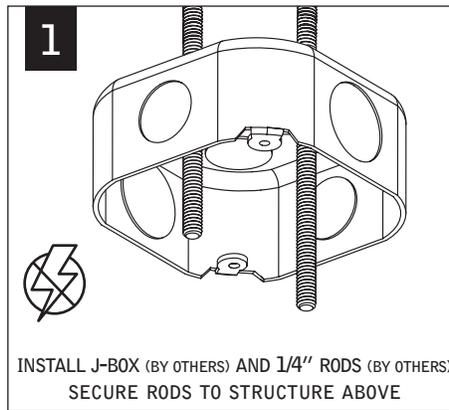







Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.

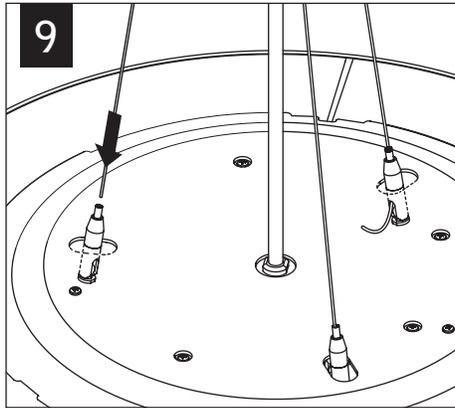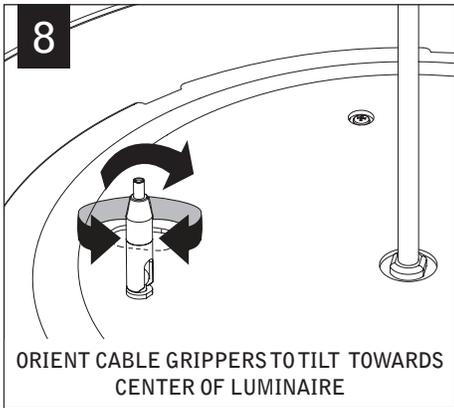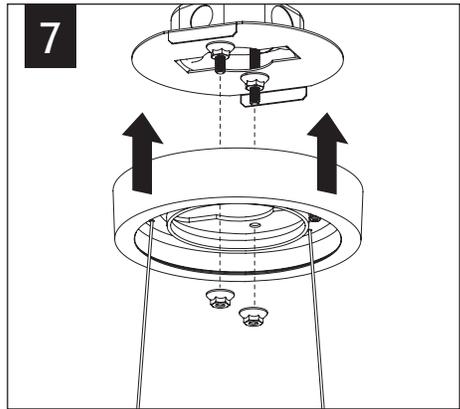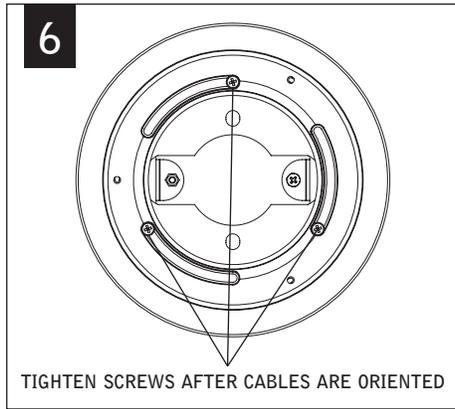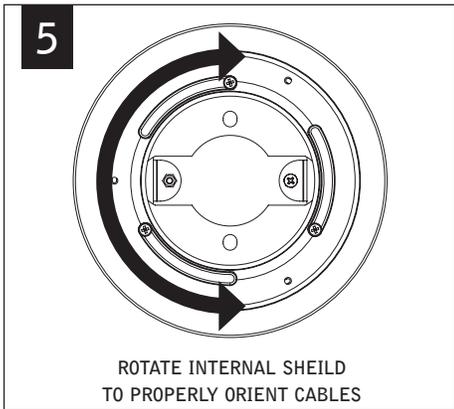





ALTERNATE CABLE INSTALLATION - OPTIONAL

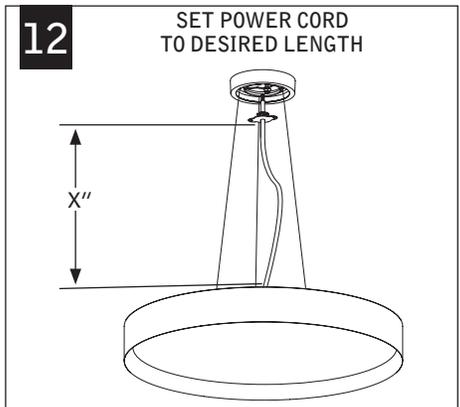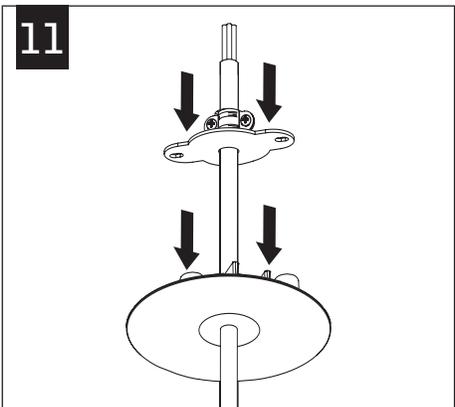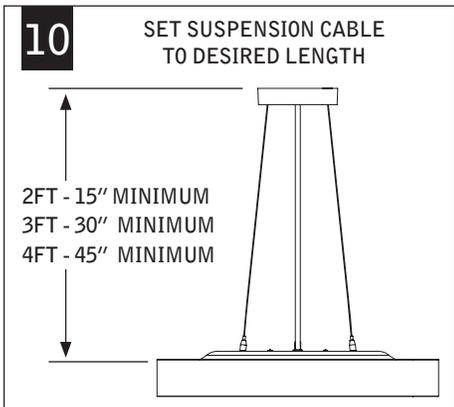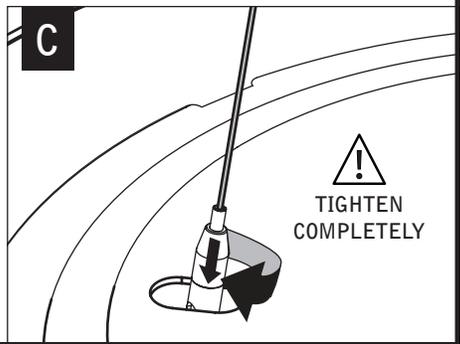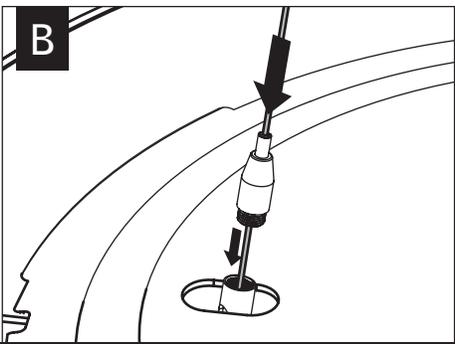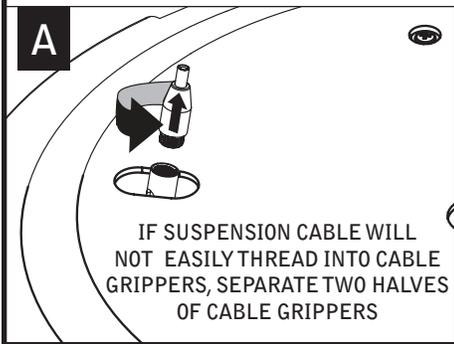

Contractor is responsible for adequately reinforcing walls and/or ceilings to support luminaire weight. Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings. The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.

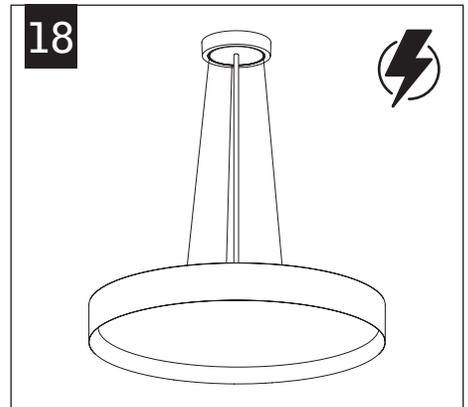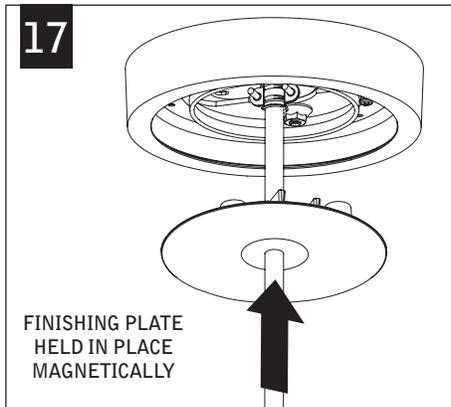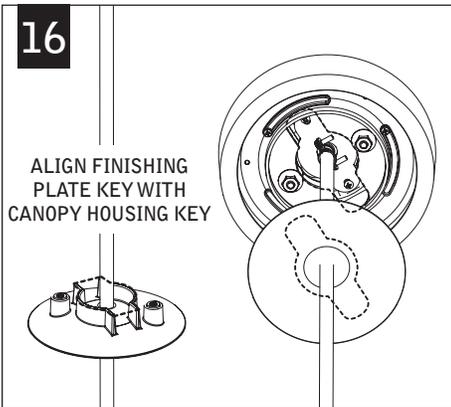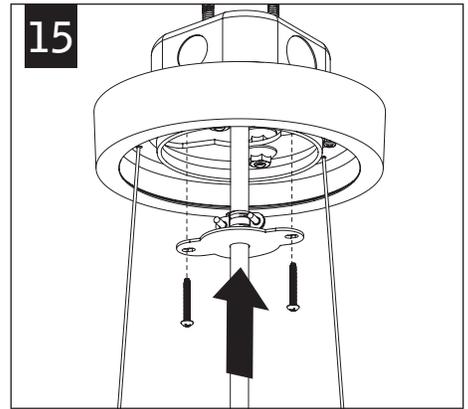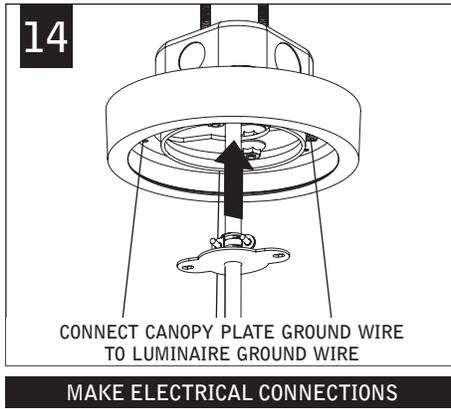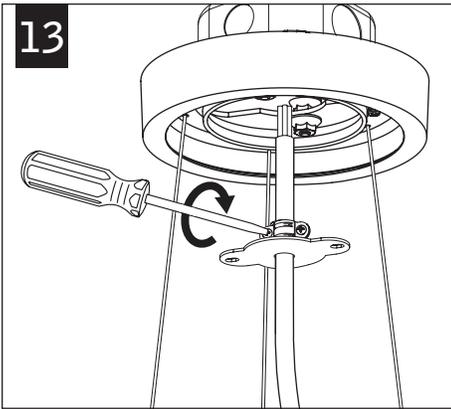

DRIVER SERVICE

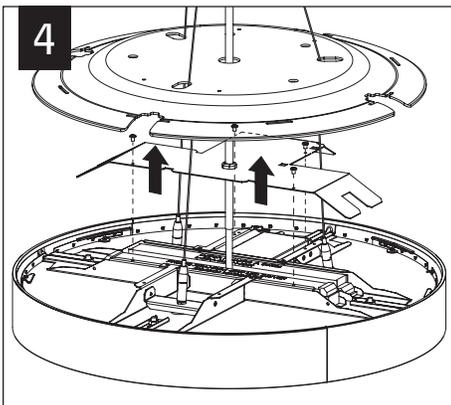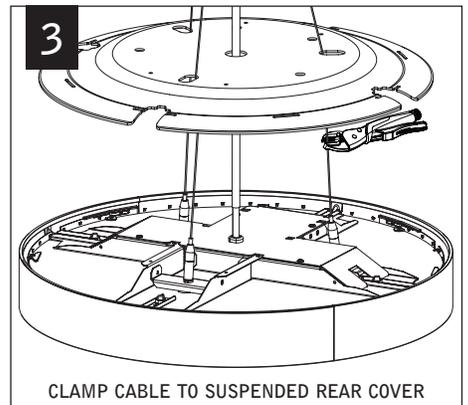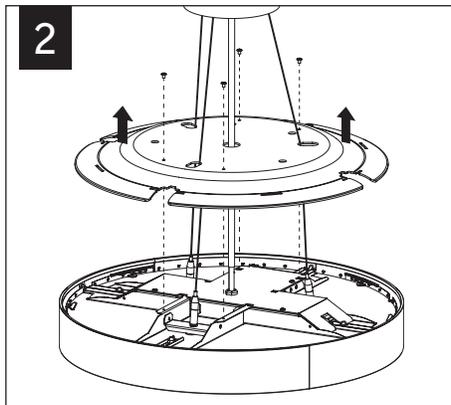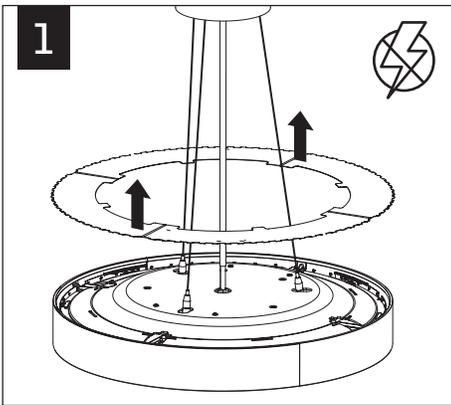

EMERGENCY

I

SEE BATTERY MANUFACTURER INSTRUCTIONS

EMERGENCY MAXIMUM MOUNTING HEIGHT:
14.25'

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.