

Seem[®] 2 LED

Grid Ceiling | FSM2L



FOCAL POINT[®]

BEFORE YOU BEGIN


- Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
- To prevent electrical shock, disconnect electrical supply before installation or servicing.
- Contractor is responsible for adequately reinforcing walls and/or ceilings to support fixture weight.
- Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings.
- The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.

INSTRUCTION KEY



- ATTENTION
- SEE ADDITIONAL INSTRUCTIONS
- POWER OFF
- POWER ON

COMPONENT KEY


FOCAL POINT

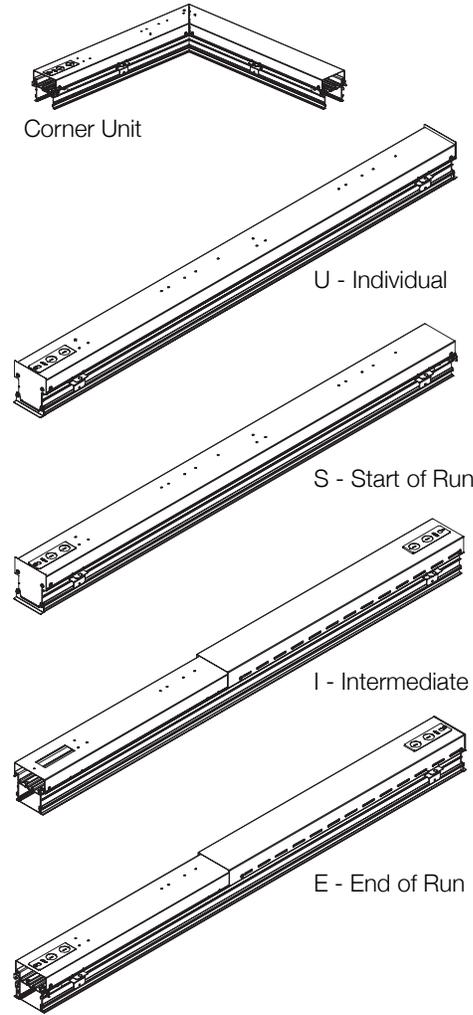

PARTS SHIPPED INSTALLED

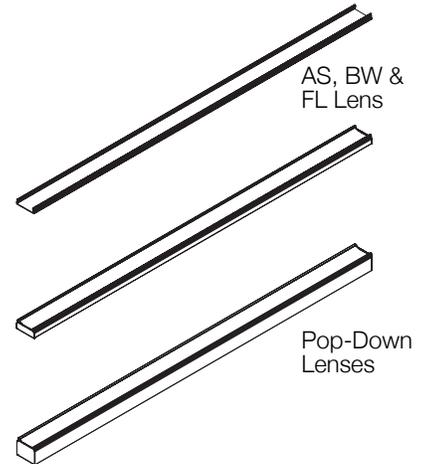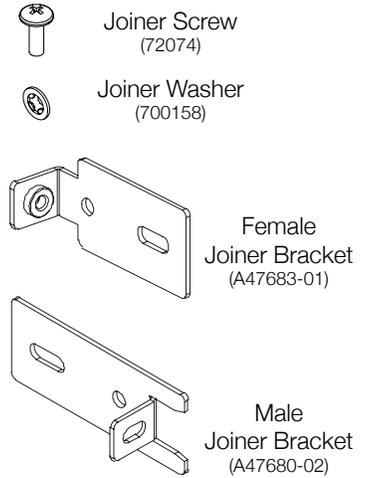

GRID MOUNT ONLY - SPACING FOR ALL GRID TYPES

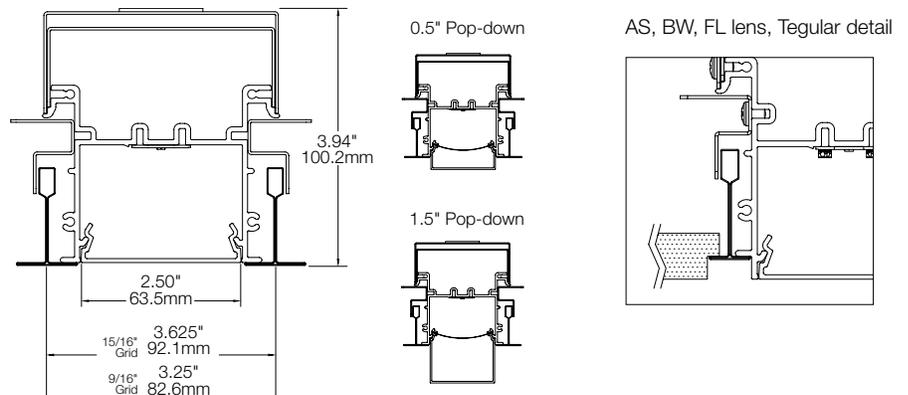

INDIVIDUAL UNITS CANNOT BE JOINED IN THE FIELD.

CORNER ASSEMBLY

A

⚡

INSTALL CORNER ASSEMBLY
PRIOR TO INDIVIDUAL UNITS

B

SECURE TO STRUCTURE ABOVE

!

JOINING INSTALLATIONS
SKIP TO STEP 3

1

⚡

2

SECURE TO
STRUCTURE
ABOVE

!

INDIVIDUAL INSTALLATIONS
SKIP TO STEP 6

NOTE: INDIVIDUAL UNITS
CANNOT BE JOINED IN THE FIELD

3

4

5

DO NOT
OVER-TIGHTEN

SECURE TO STRUCTURE ABOVE

6

⚡

MAKE ELECTRICAL CONNECTION

Asymmetric Lens Distribution Direction



EMERGENCY

I


SEE BATTERY MANUFACTURER
INSTRUCTIONS

EMERGENCY MAXIMUM MOUNTING HEIGHT:
AS, BW, FL LENS – 19.3 ft.
POP-DOWN LENS – 15.6 ft.


DRIVER SERVICE

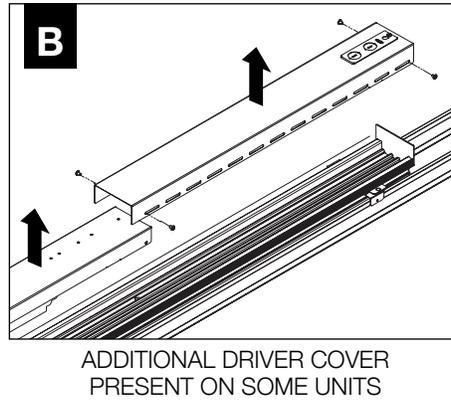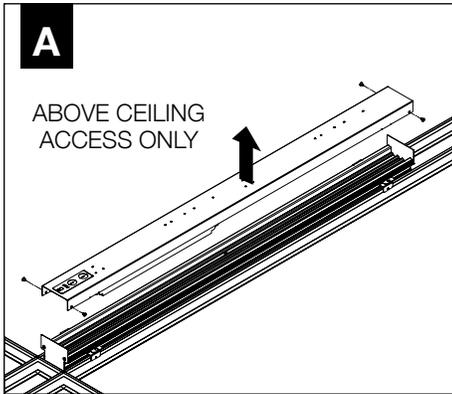

ACUITY nLIGHT

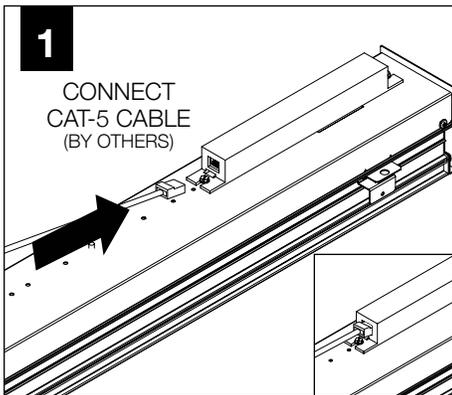

WATTSTOPPER

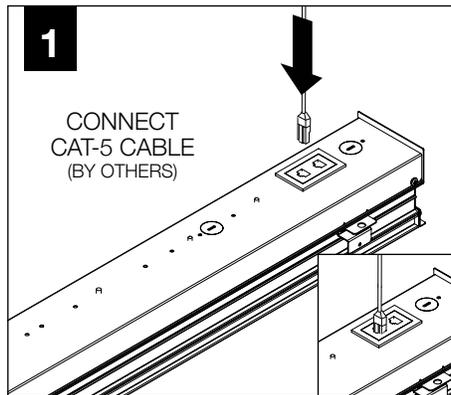

HUBBELL NX

