



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM-UNV-OW-OF-CS-WET-CC\_.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] GEN FROM BALLABS TEST NO. 20685.0

[TESTLAB] BUILDING ACOUSTICS & LIGHTING LABORATORIES, INC

[ISSUEDATE] 20 APRIL 2020

[MANUFAC] WILLIAMS INDOOR

[OTHER] H.E. WILLIAMS, INC - CARTHAGE, MO

[LUMINAIRE] 4" RND RECESSED LED CAST HOUSING DOWNLIGHT

[MORE] OPEN SEMI-SPEC SPUN ALUMINUM REFLECTOR (WIDE)

[LUMCAT] 4DR-TL-L15-835-DIM-UNV-OW-OF-CS-WET-CC

[LAMPCAT] V13 BXRE-35E2000

[\_SEARCH\_SOURCETYPE] LED

[\_SEARCH\_APPLICATION] Indoor, Classroom, Commercial, Corridor, Hotel, Industrial, Office, Downlight

[\_SEARCH\_MOUNTING] Recessed

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1246
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	89
Total Luminaire Watts	14
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.22
Spacing Criterion (90-270)	1.22
Spacing Criterion (Diagonal)	0.94
Basic Luminous Shape	Circular
Luminous Length (0-180)	0.37 ft (Diameter)
Luminous Width (90-270)	0.37 ft (Diameter)
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	3778	3778	3778
55	1165	1165	1165
65	144	144	144
75	0	0	0
85	0	0	0

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM-UNV-OW-OF-CS-WET-CC\_.IES

## CANDELA TABULATION

	<u>0</u>
0	1069.350
5	1101.254
10	1134.338
15	1157.971
20	1209.370
25	1318.078
30	1032.721
35	181.376
40	47.264
45	25.995
50	13.588
55	6.499
60	2.954
65	0.591
70	0.591
75	0.000
80	0.000
85	0.000
90	0.000

**IES INDOOR REPORT****PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM-UNV-OW-OF-CS-WET-CC\_.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	437.00	N.A.	35.10
0-30	999.58	N.A.	80.20
0-40	1216.51	N.A.	97.60
0-60	1244.63	N.A.	99.90
0-80	1245.94	N.A.	100.00
0-90	1245.94	N.A.	100.00
10-90	1140.02	N.A.	91.50
20-40	779.51	N.A.	62.60
20-50	801.07	N.A.	64.30
40-70	29.28	N.A.	2.40
60-80	1.32	N.A.	0.10
70-80	0.15	N.A.	0.00
80-90	0.00	N.A.	0.00
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	1245.94	N.A.	100.00

Total Luminaire Efficiency = N.A.%

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	105.92
10-20	331.08
20-30	562.58
30-40	216.93
40-50	21.56
50-60	6.55
60-70	1.16
70-80	0.15
80-90	0.00
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM-UNV-OW-OF-CS-WET-CC\_.IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	102	101	100	98	98	97	96	94
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82
4	98	91	85	81	96	90	85	81	87	83	80	85	82	79	84	81	78	77
5	93	85	79	75	92	84	79	75	82	78	74	81	77	74	79	76	73	72
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59
9	76	67	61	57	75	66	61	57	66	60	57	65	60	57	64	60	57	55
10	73	63	58	54	72	63	57	54	62	57	54	61	57	53	61	56	53	52

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM-UNV-OW-OF-CS-WET-CC\_.IES

## UGR TABLE - CORRECTED

### Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

### Room Size UGR Viewed Crosswise


X=2H	Y=2H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	3H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	4H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	6H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	8H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	12H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8

### UGR Viewed Endwise

4H	2H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	3H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	4H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	6H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	8H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	12H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
8H	4H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	6H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	8H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	12H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
12H	4H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	6H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	8H	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8

Maximum UGR = 0.8

POLAR GRAPH

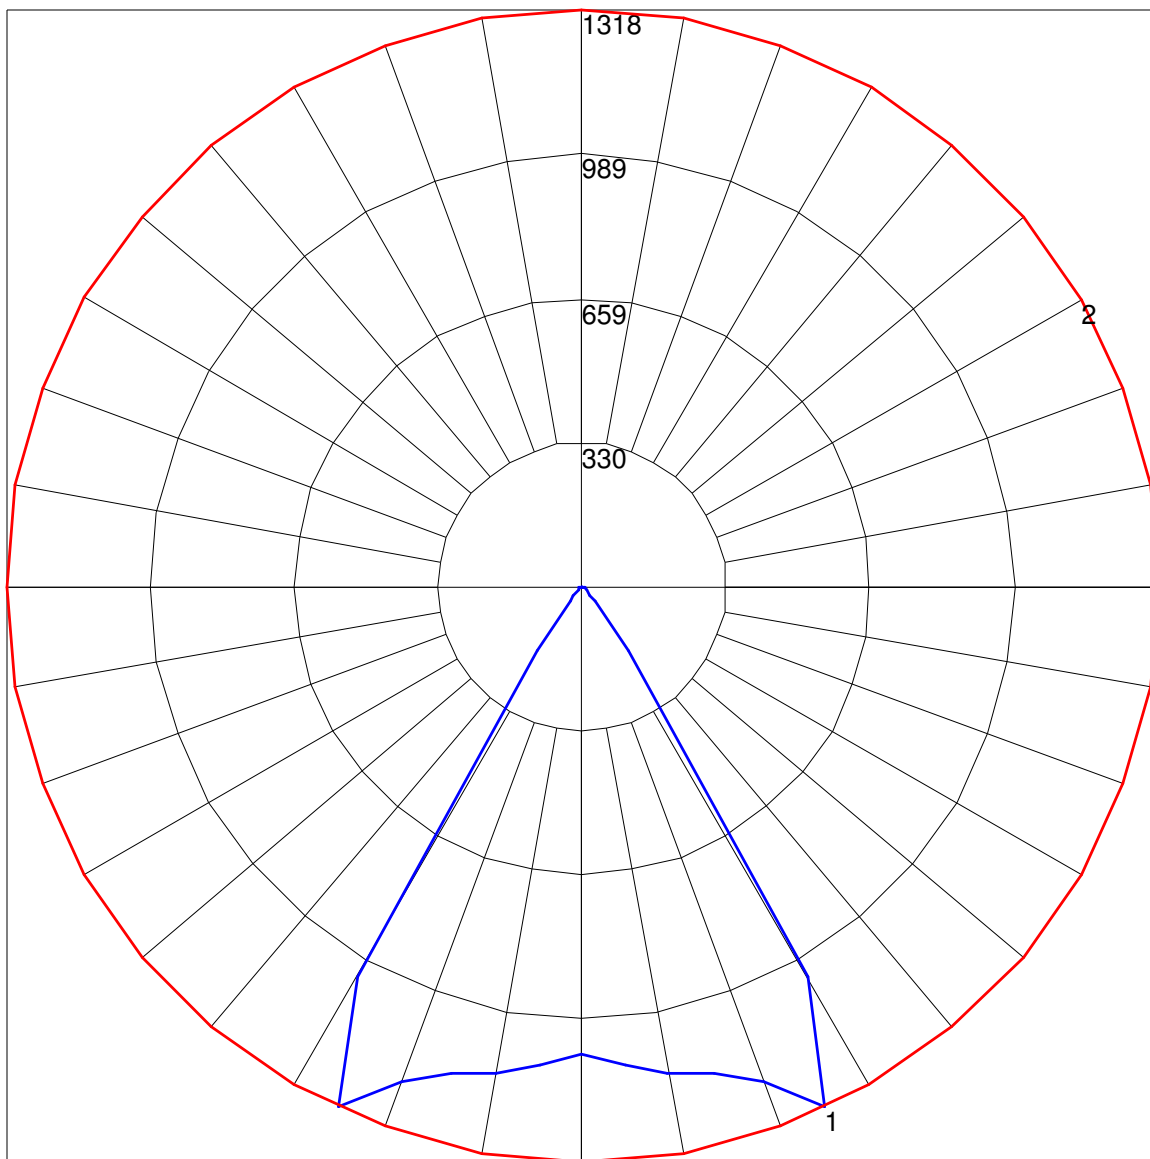

Maximum Candela = 1318.078 Located At Horizontal Angle = 0, Vertical Angle = 25  
# 1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (25) (Through Max. Cd.)