

## IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM1-UNV-OW-OF-WH\_.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST]GEN FROM BALLABS TEST NO. 20685.0

[TESTLAB] BUILDING ACOUSTICS & LIGHTING LABORATORIES, INC

[ISSUE DATE] 08-22-2023

[MANUFAC] WILLIAMS INDOOR

[OTHER] H.E. WILLIAMS, INC - CARTHAGE, MO

[MORE] OPEN WHITE ALUMINUM REFLECTOR (WIDE)

[LUMCAT] 4DR-TL-L15-835-DIM1-UNV-OW-OF-WH

[\_SEARCH\_SOURCE TYPE] LED

[\_SEARCH\_APPLICATION] Indoor, Classroom, Commercial, Corridor, Hotel, Industrial, Office, Downlight

[\_SEARCH\_MOUNTING] Recessed

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1346
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	92
Total Luminaire Watts	14.57
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.22
Spacing Criterion (90-270)	1.22
Spacing Criterion (Diagonal)	0.94
Basic Luminous Shape	Circular
Luminous Length (0-180)	0.37 ft (Diameter)
Luminous Width (90-270)	0.37 ft (Diameter)
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	4081	4081	4081
55	1258	1258	1258
65	155	155	155
75	0	0	0
85	0	0	0

IES INDOOR REPORT  
PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM1-UNV-OW-OF-WH\_.IES

CANDELA TABULATION

	<u>0</u>
0	1154.899
5	1189.354
10	1225.086
15	1250.608
20	1306.120
25	1423.524
30	1115.339
35	195.886
40	51.045
45	28.075
50	14.676
55	7.019
60	3.190
65	0.638
70	0.638
75	0.000
80	0.000
85	0.000
90	0.000

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM1-UNV-OW-OF-WH\_.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	471.96	N.A.	35.10
0-30	1079.55	N.A.	80.20
0-40	1313.83	N.A.	97.60
0-60	1344.2	N.A.	99.90
0-80	1345.62	N.A.	100.00
0-90	1345.62	N.A.	100.00
10-90	1231.22	N.A.	91.50
20-40	841.87	N.A.	62.60
20-50	865.16	N.A.	64.30
40-70	31.62	N.A.	2.30
60-80	1.42	N.A.	0.10
70-80	0.17	N.A.	0.00
80-90	0.00	N.A.	0.00
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	1345.62	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	114.40
10-20	357.57
20-30	607.58
30-40	234.29
40-50	23.29
50-60	7.08
60-70	1.25
70-80	0.17
80-90	0.00
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM1-UNV-OW-OF-WH\_.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82
4	98	91	85	81	96	90	85	81	87	83	80	85	82	79	84	81	78	77
5	93	85	79	75	92	84	79	75	82	78	74	81	77	74	79	76	73	72
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59
9	76	67	61	57	75	66	61	57	65	60	57	65	60	57	64	60	57	55
10	73	63	58	54	72	63	57	54	62	57	54	61	57	53	61	56	53	52


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : 4DR-TL-L15-835-DIM1-UNV-OW-OF-WH\_.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	3H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	4H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	6H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	8H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	12H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
4H	2H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	3H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	4H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	6H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	8H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	12H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
8H	4H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	6H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	8H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	12H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
12H	4H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	6H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
	8H	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0

Maximum UGR = 1.0

POLAR GRAPH

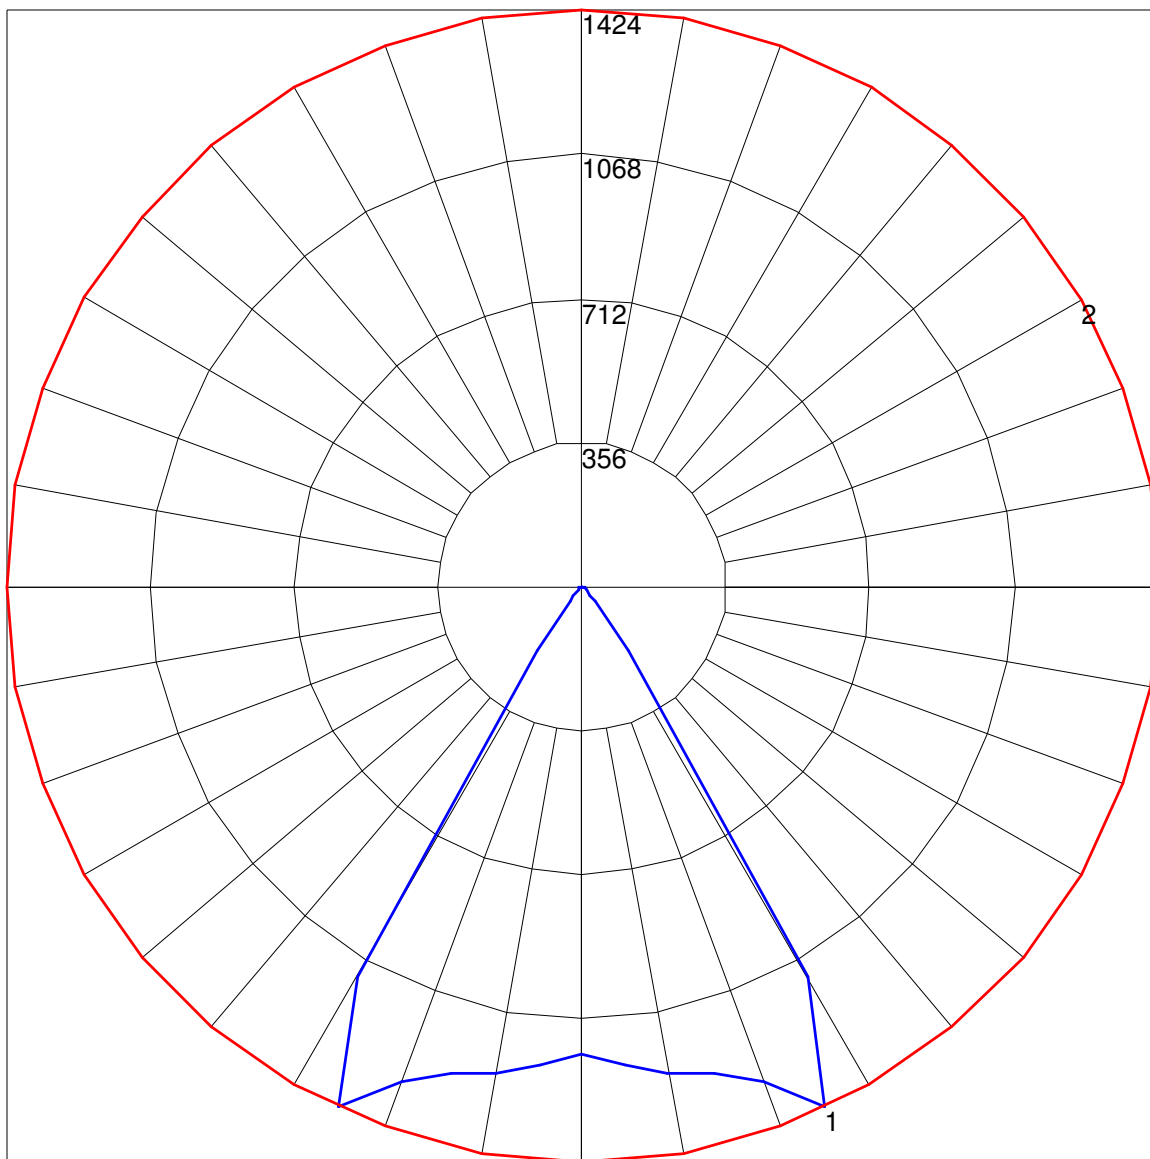

Maximum Candela = 1423.524 Located At Horizontal Angle = 0, Vertical Angle = 25  
# 1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (25) (Through Max. Cd.)